


SIDEWALK CONSTRUCTION

(NOT TO SCALE)

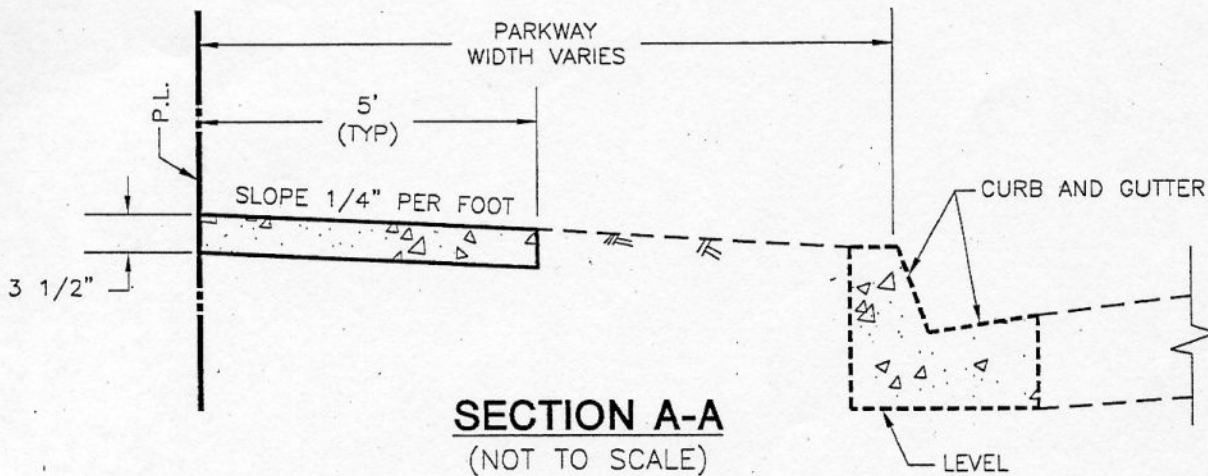

NOTES:

1. ALL WORK SHALL BE CONSTRUCTED IN ACCORDANCE WITH THE LATEST ADOPTED STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION.
2. CONCRETE SHALL BE CLASS 520-C-2500.
3. 1/2" THICK TRANSVERSE EXPANSION JOINTS SHALL BE PLACED AT CURB RETURNS AND AROUND DRAINAGE STRUCTURES, POLES, PIPES, ETC., IN THE SIDEWALK. FULL WIDTH PARKWAY SIDEWALK SHALL HAVE THE EXPANSION JOINTS AT THE SAME LOCATION AS THOSE IN THE CURB.
4. ALL JOINTS AND SCORING LINES PER GREENBOOK SECTION 303-5.

CITY OF BURBANK - PUBLIC WORKS DEPARTMENT

REV	BY	DATE	<p style="text-align: center;">SIDEWALK</p>	<p style="text-align: center;">STANDARD PLAN BS-104-1 SHEET 1 OF 1</p>